

CONCRETE SIDEWALK 4000 PSI  
MAGNESIUM FLOAT FINISH - REFER  
TO CITY OF ALBANY REGULATION

5" x 16" GRANITE CURB

6" MINIMUM SUB COURSE:  
CRUSHED STONE - TYPE 2  
NYS DOT ITEM - 304.03

CONCRETE: FOUNDATION CLASS "C"  
0 PSI N.Y.S.D.O.T. ITEM 503.0101  
H SIDES OF CURB

EXISTING CURB TRENCH  
SUBGRADE

6" MINIMUM DRY MIX CONCRETE  
AT EACH END OF CURB  
SECTION

SAW CUT  
24" MIN.


6" REVEAL

EXISTING PAVEMENT  
EXISTING SUB PAVEMENT

NOTE:  
REPLACEMENT OF STREET PAVEMENT,  
REFER TO DETAIL'S IN CITY PERMIT  
REGULATIONS TO CONFORM TO  
EXISTING CONDITIONS

# GRANITE CURB DETAIL


NO SCALE

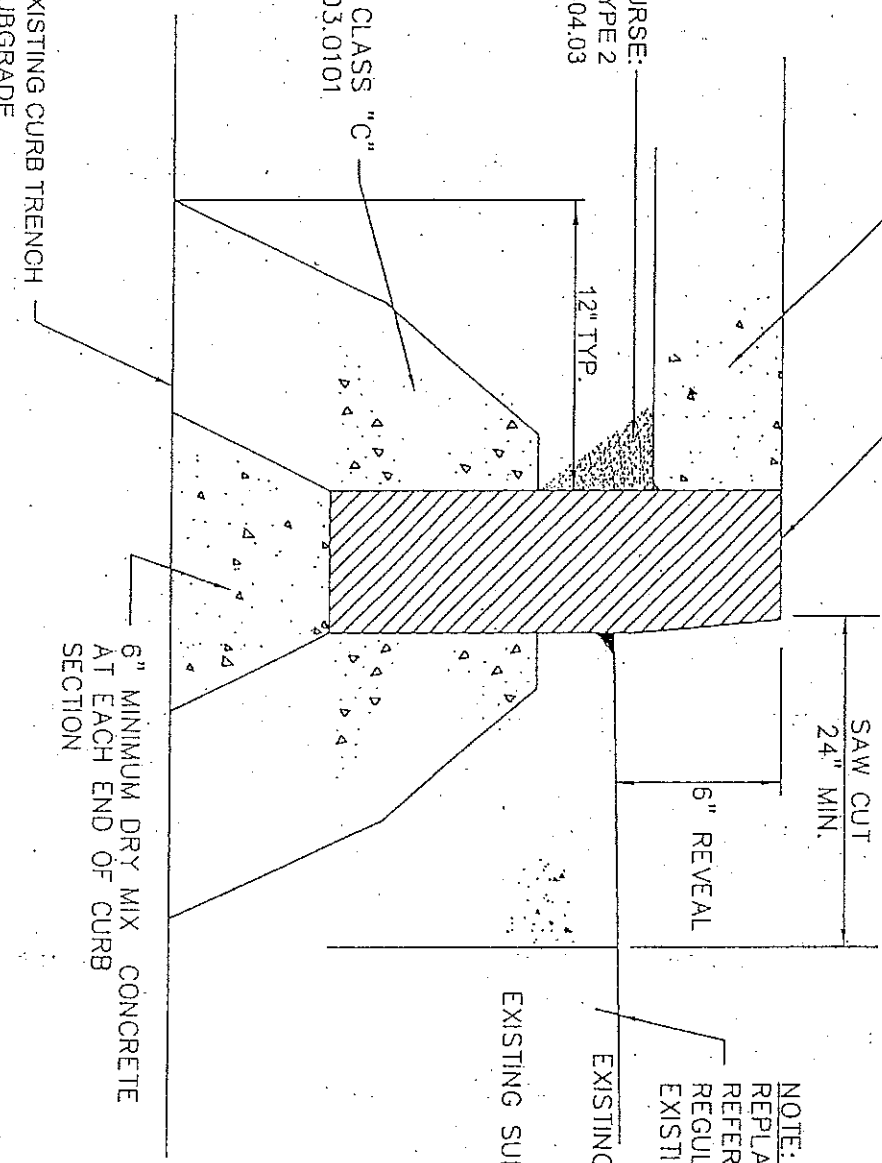

AREAS WITH SIDEWALK  
NOT ADJACENT TO CURB

DRIVEWAY APRON DETAIL

NO SCALE

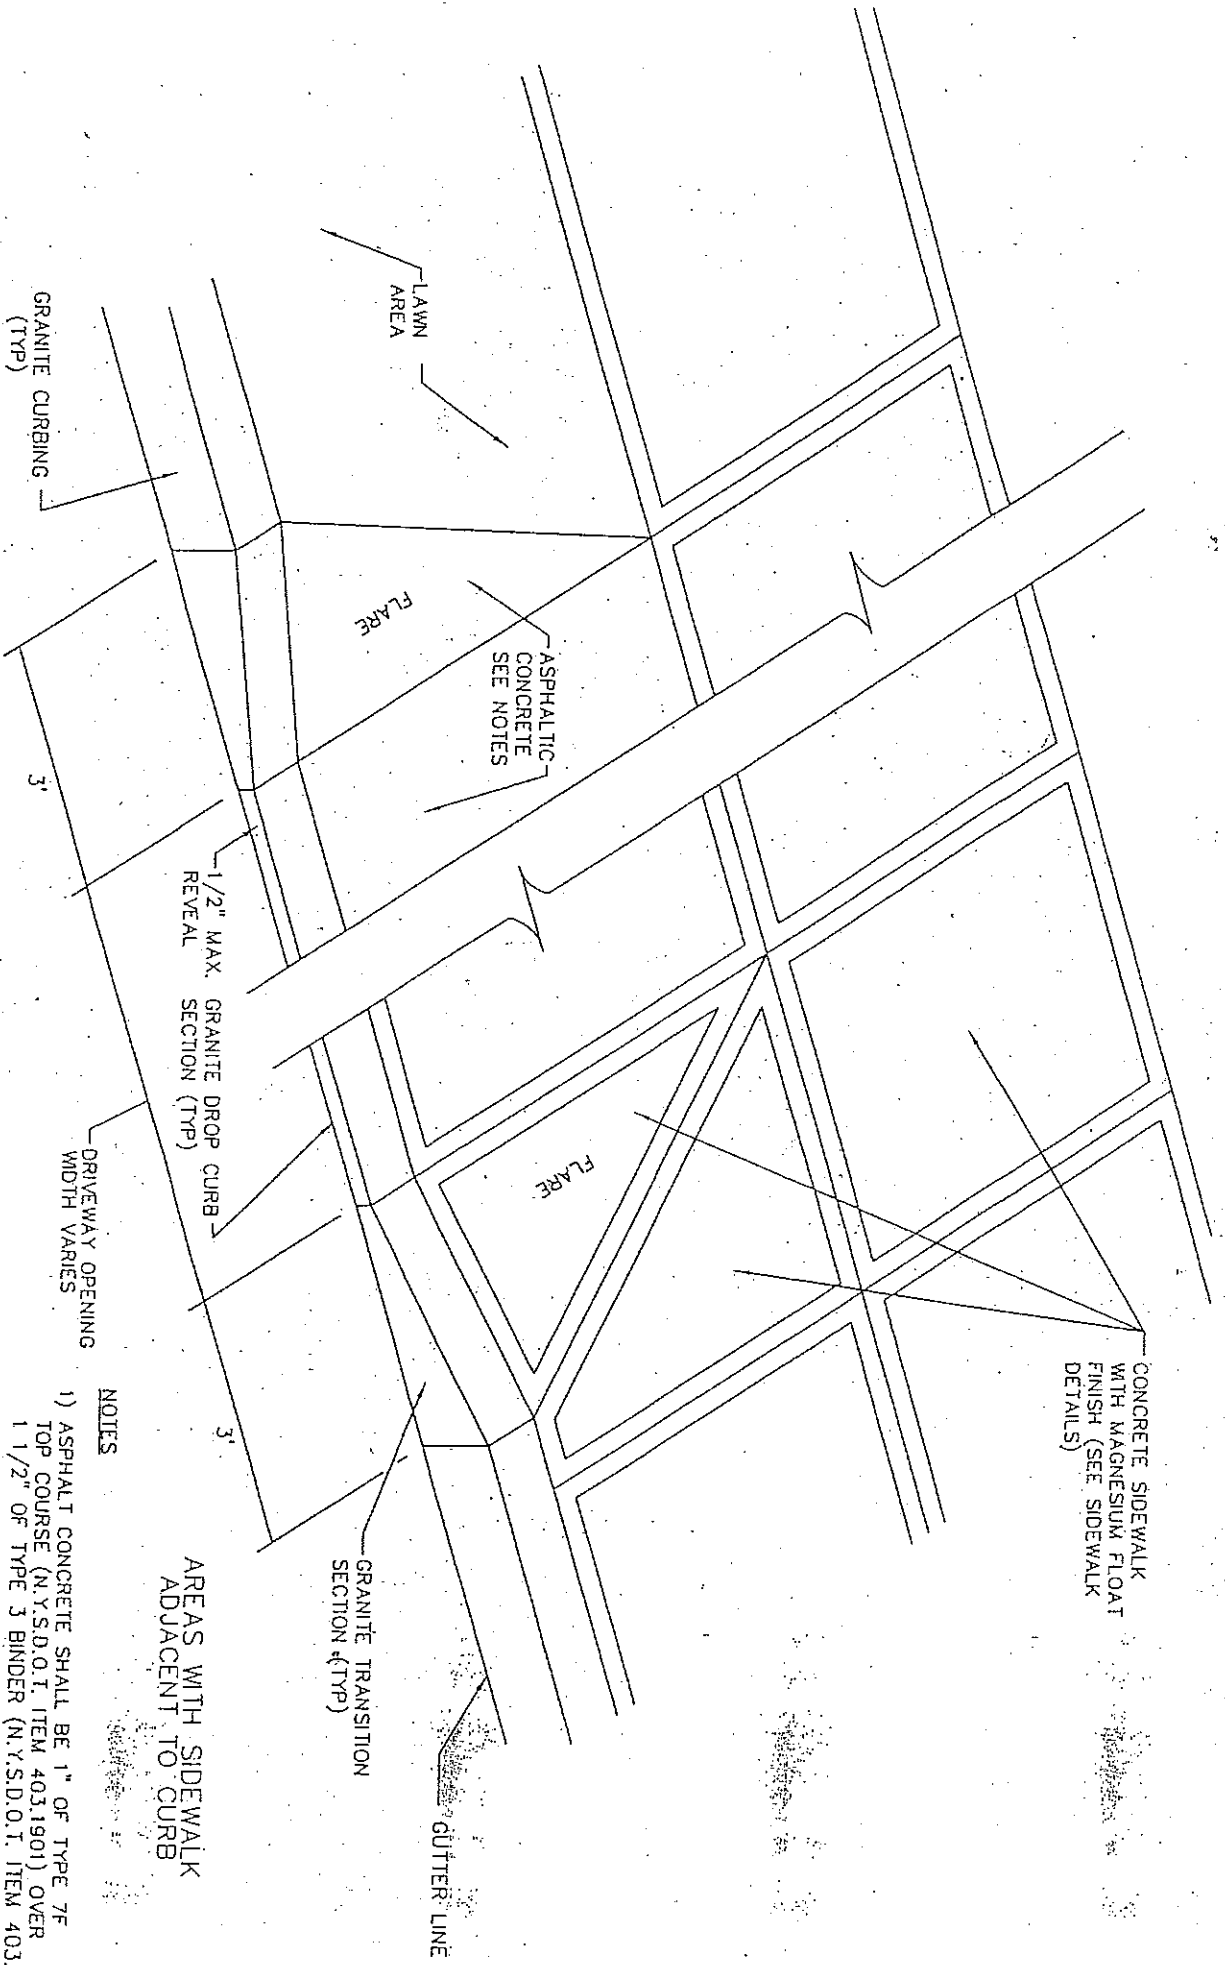

**NOTES**

- 1) ASPHALT CONCRETE SHALL BE 1" OF TYPE 7F TOP COURSE (N.Y.S.D.O.T. ITEM 403.1901) OVER 1 1/2" OF TYPE 3 BINDER (N.Y.S.D.O.T. ITEM 403.13)
- 2) ASPHALT CONCRETE SHALL BE PLACED OVER 8" OF COMPACTED CRUSHED STONE SUBBASE

AREAS WITH SIDEWALK  
ADJACENT TO CURB